
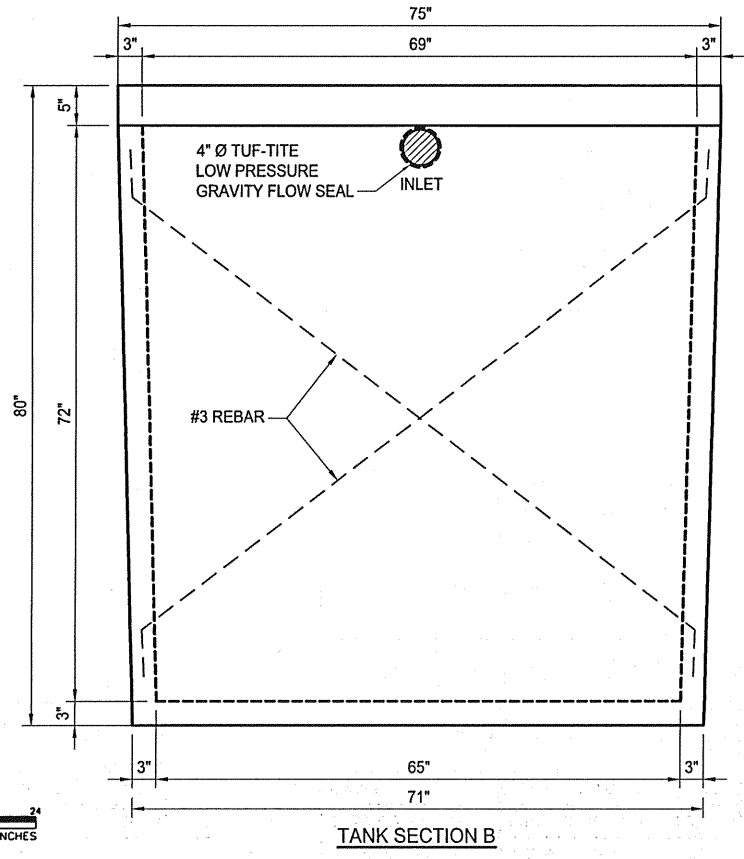


GENERAL NOTES:

- ALL CONCRETE TO BE 4000 PSI, WITH A MAXIMUM AGGREGATE SIZE OF 3/4".
- ALL INSPECTION HOLES AND TOPS ARE TO BE SEALED WITH A NEOPRENE SEALER.
- THE SUB GRADE IS TO BE WITHIN 1/2" AND FREE OF FOREIGN OBJECTS.
- PRE-TREATMENT TANK & CLARIFIER RISERS MAY BE BELOW GRADE.
- TANK LID TO BE SEALED WITH ASPHALTIC SEALANT.

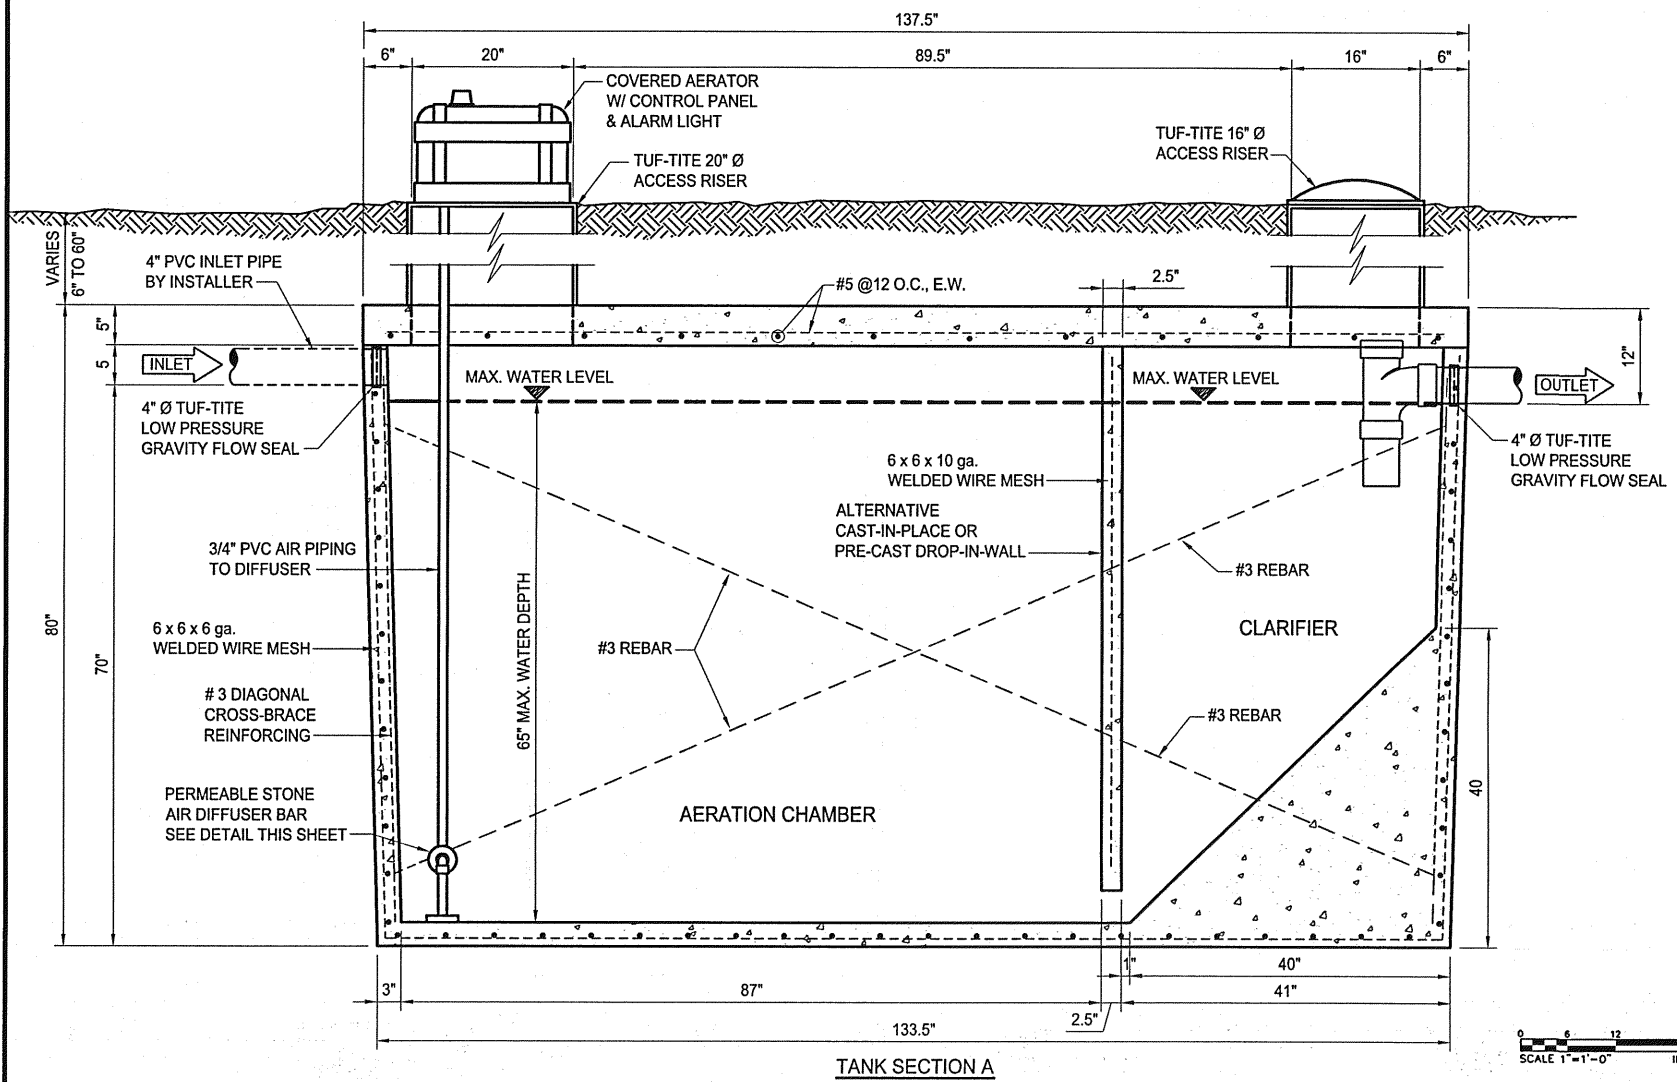

WATERENGINEERS, INC.
 TBPE FIRM REGISTRATION No. 2066

STATE OF TEXAS
 D. RAY YOUNG
 37068
 REGISTERED PROFESSIONAL ENGINEER

D. Ray Young
 JAN. 17, 2006

WASTEWATER TREATMENT STRUCTURE MODEL No. 1500-S		
PRO FLO WASTEWATER TREATMENT SYSTEMS 20222 FM 362 WALLER, TX. 77484		
Water Engineers, Inc. Water & Wastewater Treatment Consultants 17230 HUFFMEISTER ROAD CYPRESS, TEXAS 77429		
TEL: 281-373-0500 FAX: 281-373-1113		
DRAWN BY: JLW	SCALE: AS NOTED	DATE: 01-19-06
DESIGNED BY: DRY	CHECKED BY: DRY	REV. No.: 00
APPROVED BY: DRY	JOB No.: 4604.1	SHEET: 1